





- ① PLASTIC VALVE BOX TO PROVIDE ACCESS.
- ② 3M DBR/Y-6 SPLICE KIT OR EQUIVALENT DIRECT BURIAL SPLICE KIT
- ③ DIRECT BURIAL 1 PAIR, TWISTED SHIELDED CABLE. RECOMMENDED MINIMUM CONDUCTOR SIZE 18 AWG. DO NOT EXCEED CABLE LENGTH RECOMMENDATIONS AS SPECIFIED BY CONTROLLER/DECODER MANUFACTURER
- ④ QS200 ULTRASONIC FLOWMETER
- ⑤ TEE COMPATIBLE WITH QS200 (FLOMEC QS200 TEE RECOMMENDED FOR BEST RESULTS). SELECT TEE SIZE PER APPLICATION FLOW RATES REQ'D (SEE DATA SHEET)
- ⑥ QUICK RELEASE PIN
- ⑦ GRAVEL - GRAVEL SHALL BE PLACED AT BOTTOM OF METER TEE AND SHALL BE A MINIMUM OF 10-INCH THICK (10-INCH DEEP)

**NOTE 1:**  
5Xs MEANS 5 TIMES PIPE'S INNER DIAMETER AND 10Xs MEANS 10 TIMES PIPE'S INNER DIAMETER

**NOTE 2:**  
FOR 1-INCH PIPE INSTALLATIONS, THIS ANGLE IS ESPECIALLY IMPORTANT AND SHOULD BE SET AT 45 DEGREES FOR MOST ACCURATE METER OPERATION

**NOTE 3:**  
BURIED CABLE ENROUTE TO IRRIGATION CONTROLLER OR DECODER

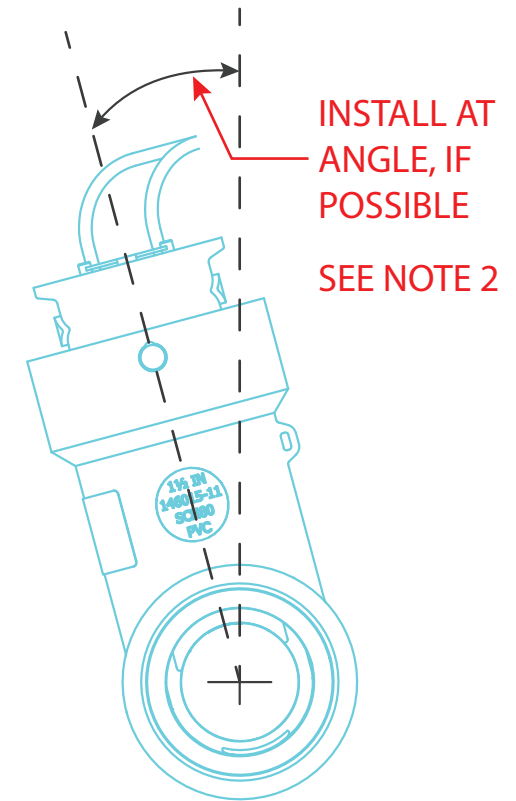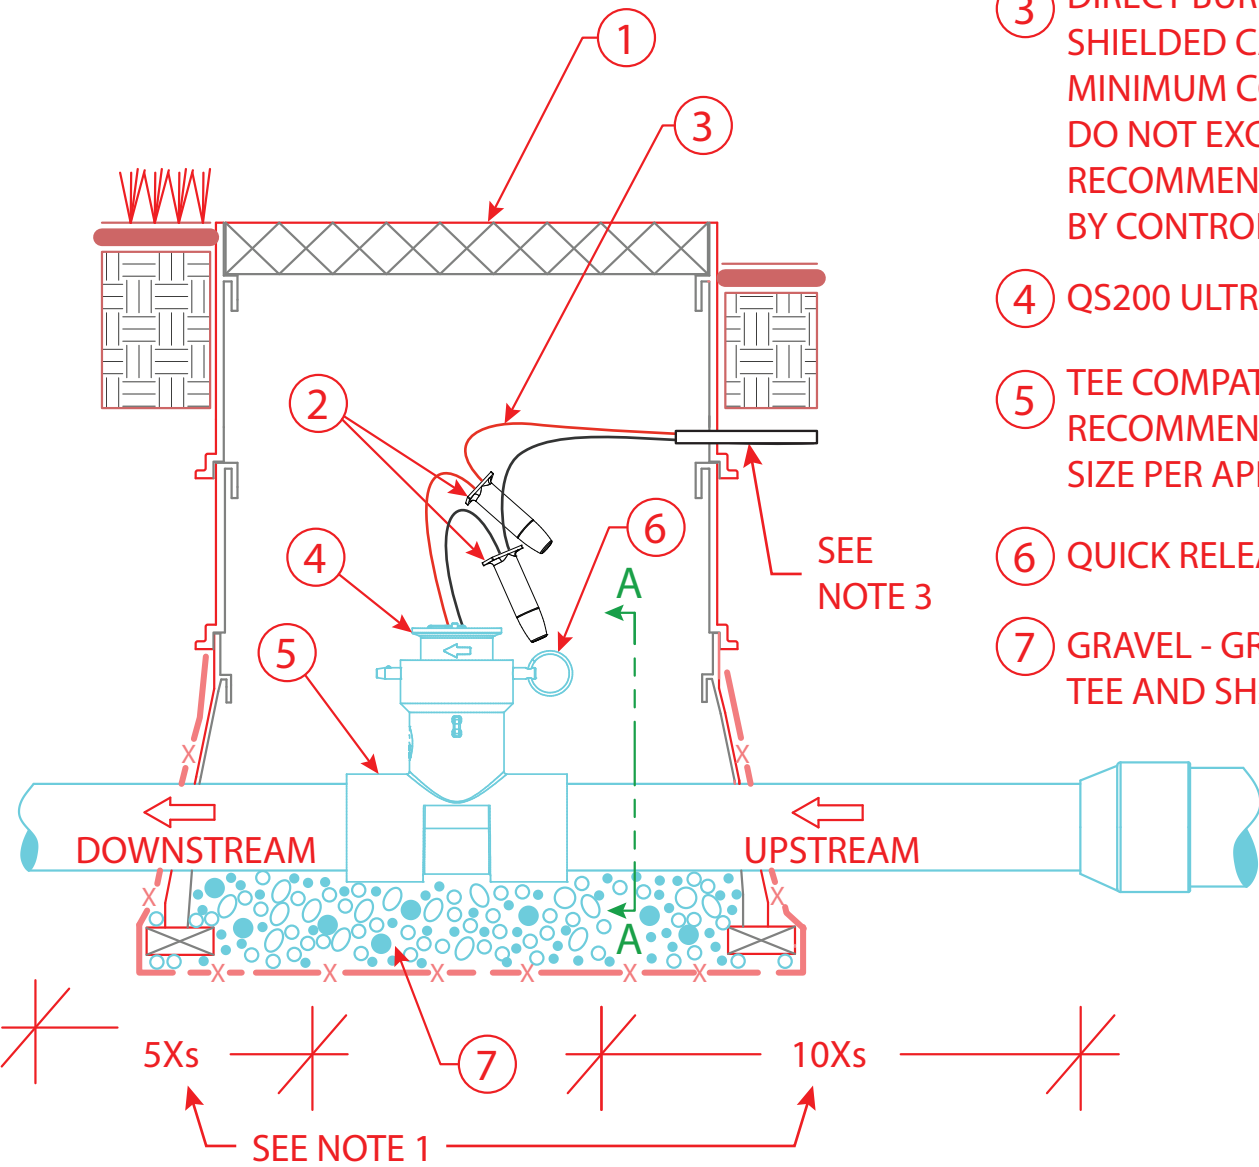

**01 SECTION A-A**  
N.T.S.

## QS200 FLOWMETER INSTALLATION

Wichita · Sydney

GREAT PLAINS INDUSTRIES



Great Plains Industries, Inc. / 888-996-3837 / FLOMEC.net  
Great Plains Industries, Inc. Australia / +61 2 9540 4433 / FLOMEC.net

**00**

## FLOMEC FLOWMETER INSTALLATION

N.T.S.

IND-1125 REV-